

NOTES:

LABEL 1 TO BE TIE-WRAPPED ONTO CABLE OUTER SHEATH.

LABEL 2 TO BE TIE-WRAPPED ONTO CABLE OUTER SHEATH.

LABEL 3 TO BE FITTED ONTO CUT OUT FUSE COVER - ONLY.

LABEL 4 TO BE FITTED ONTO CUT OUT FUSE COVER - ONLY.

LABELS SHALL BE MANUFACTURED FROM WHITE PLASTIC.


ALL CHARACTERS ON LABELS SHALL BE BLACK.

LABELS 1 AND 2 SHALL BE 45mm x 20mm X 1.5mm.

FIXING HOLES 3mm X 3mm FROM FLATS AND 5mm DIAMETER.

LABELS 3 AND 4 SHALL BE 45mm x 20mm X 1.5mm. AND SUITABLE FOR FIXING ONTO A THERMOPLASTIC MATERIAL.

THE ADHESIVE UTILISED TO FIX LABEL 3 AND 4 SHOULD BE SUITABLE FOR TEMPERATURE RANGE MINUS 10°C - PLUS 40°C .

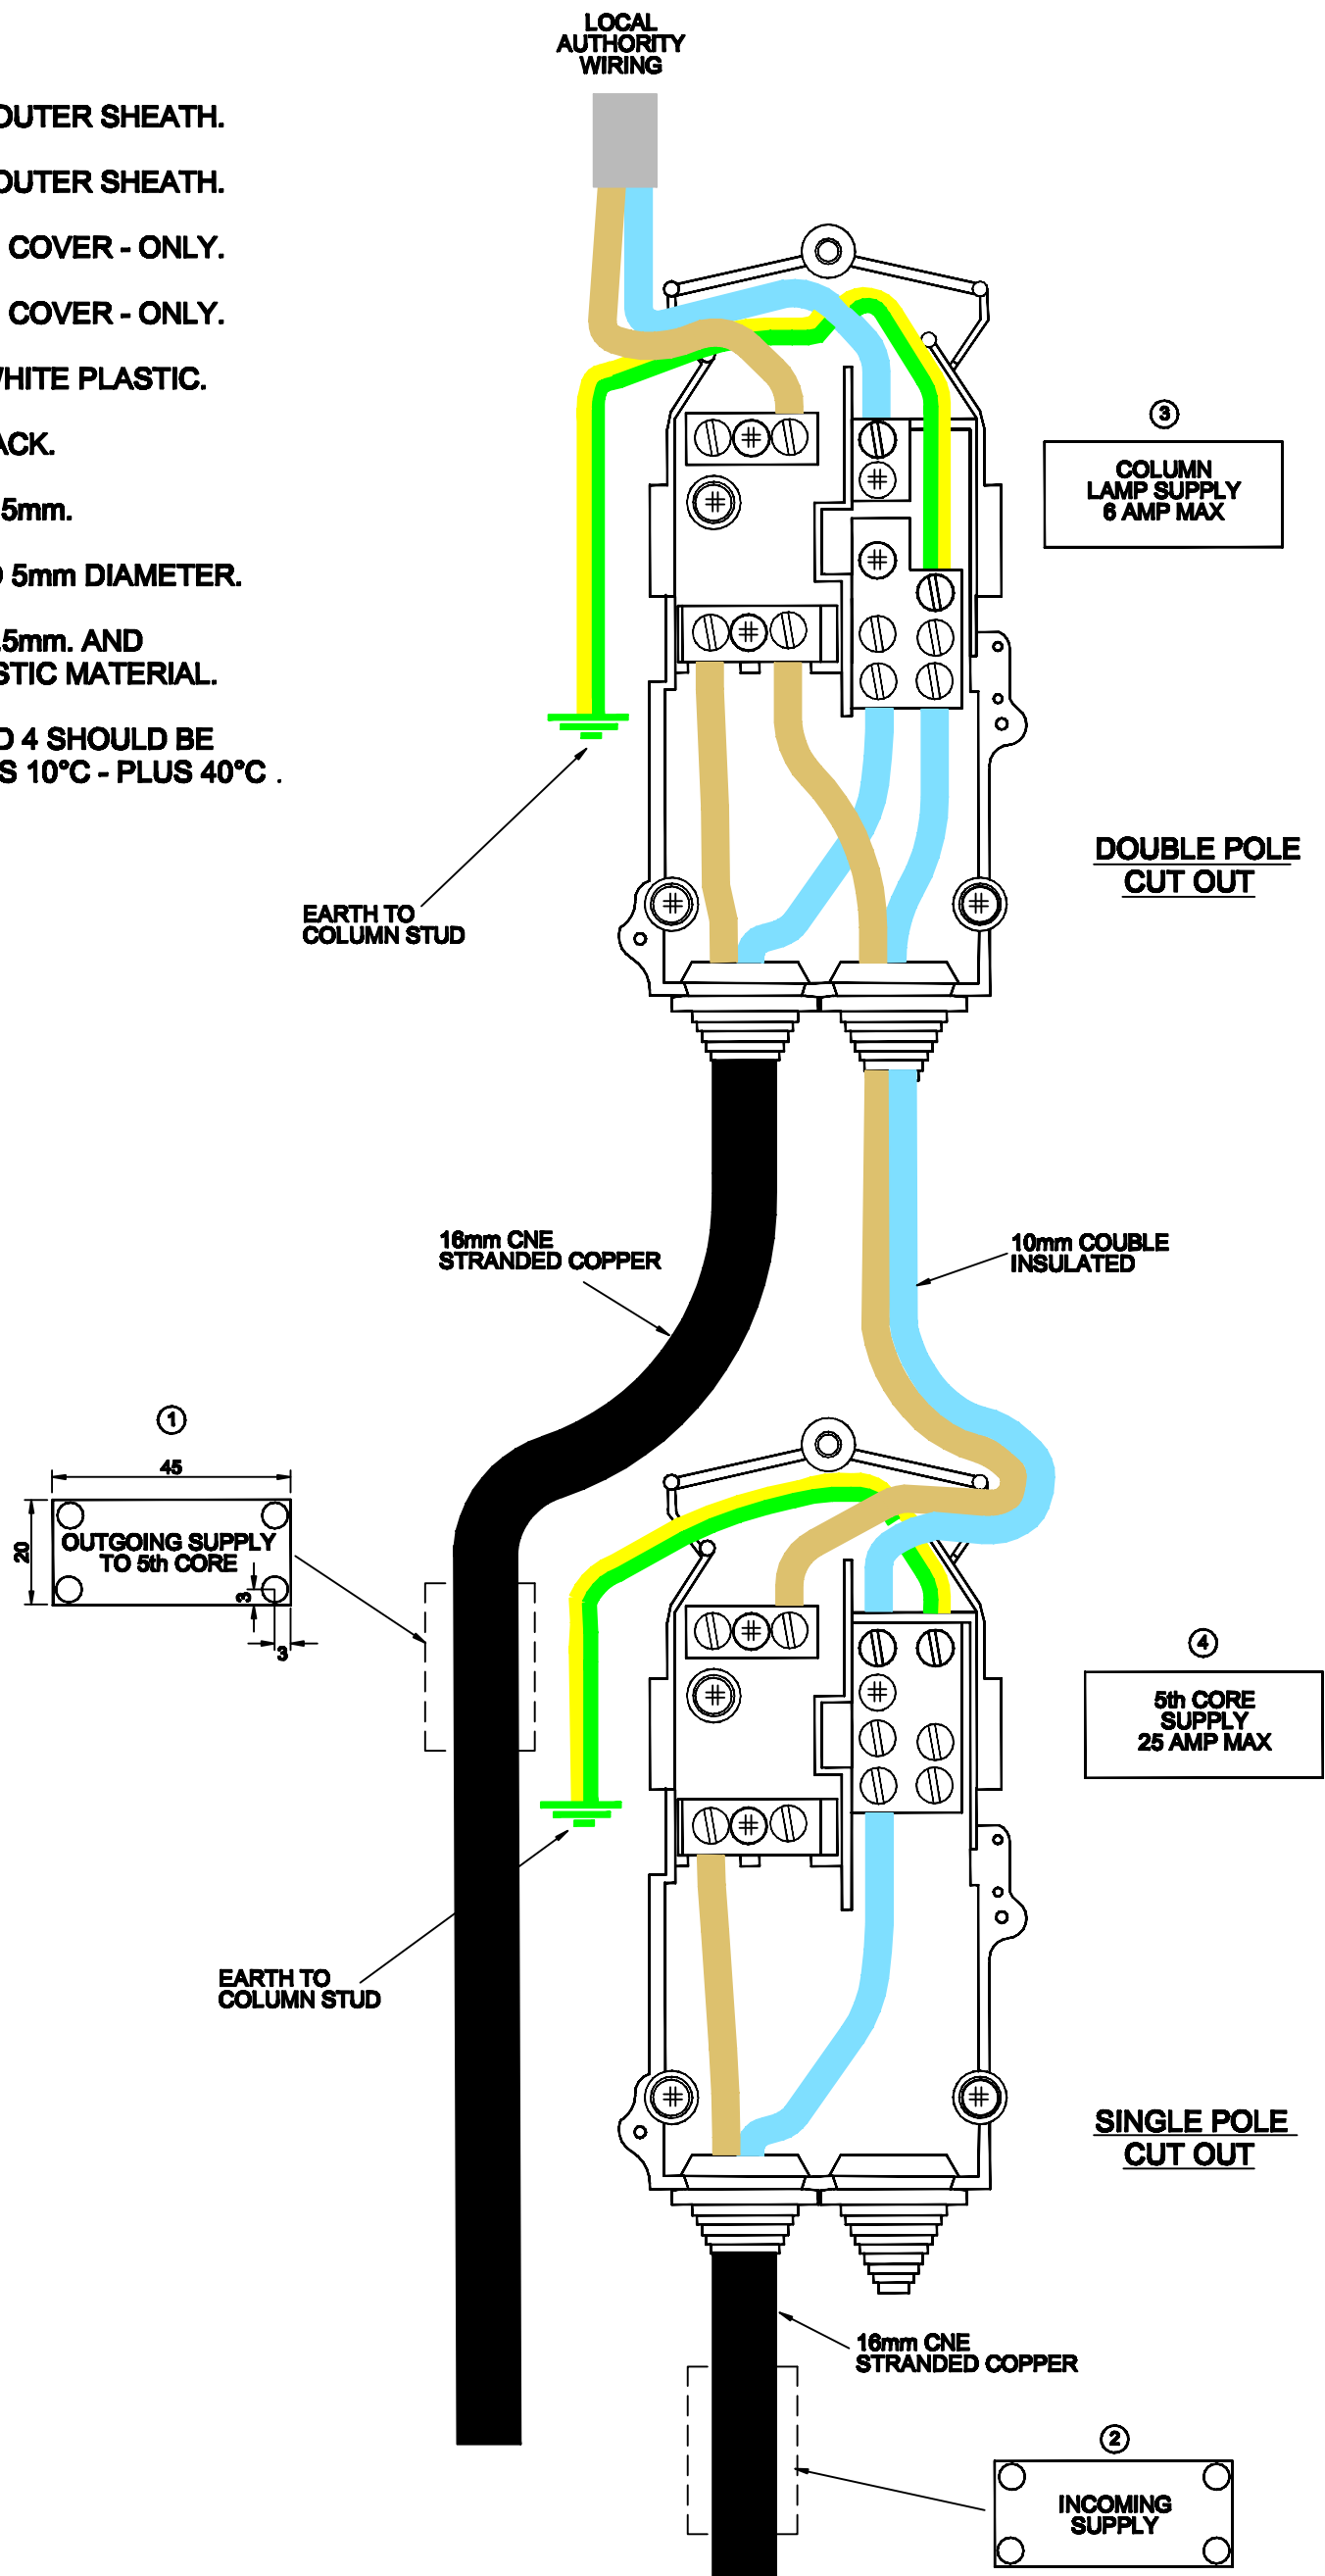

		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
		PUBLIC LIGHTING TERMINATION FOR 5TH CORE CONTROL NETWORK 16MM CNE COPPER SERVICE CABLE	
Manufacturer Details		Type	
Sheet No. 1	Scale N.T.S.	OTHER PLANT	
Prepared By Lesley.Hughes		METERING	
Revised 11/09/12	Grid Reference	Ref No. C1010662	Historic Drg.No. 1121010051
Date Issued 21/06/12	Checked By B MORLAND	Revision A	Notes